

Sample Alcohol Monitoring Evidence: Understanding Soberlink’s Client Detail Report

Soberlink’s **Advanced Reporting** is an essential tool for attorneys requiring reliable, efficient, and easy-to-understand alcohol testing evidence for custody cases.

Advanced Reporting consists of:

- Testing results summary
- Calendar format with icons indicating each test result
- Test detail summaries outlining each positive test


These features ensure that evidence on alcohol testing is not only meticulously recorded and easily interpreted but also legally robust, catering to the stringent demands of family law.

Notarization Process:

In legal matters that require an affidavit accompanied by certified records, Soberlink streamlines obtaining notarized evidence to support your case. Contact our Compliance Team at compliance@soberlink.com to request your records which will be sent within two business days for a one-time fee of \$50, billed to the Soberlink subscription holder.

Example Weekly Report:

Soberlink also provides Daily and Monthly Reports.

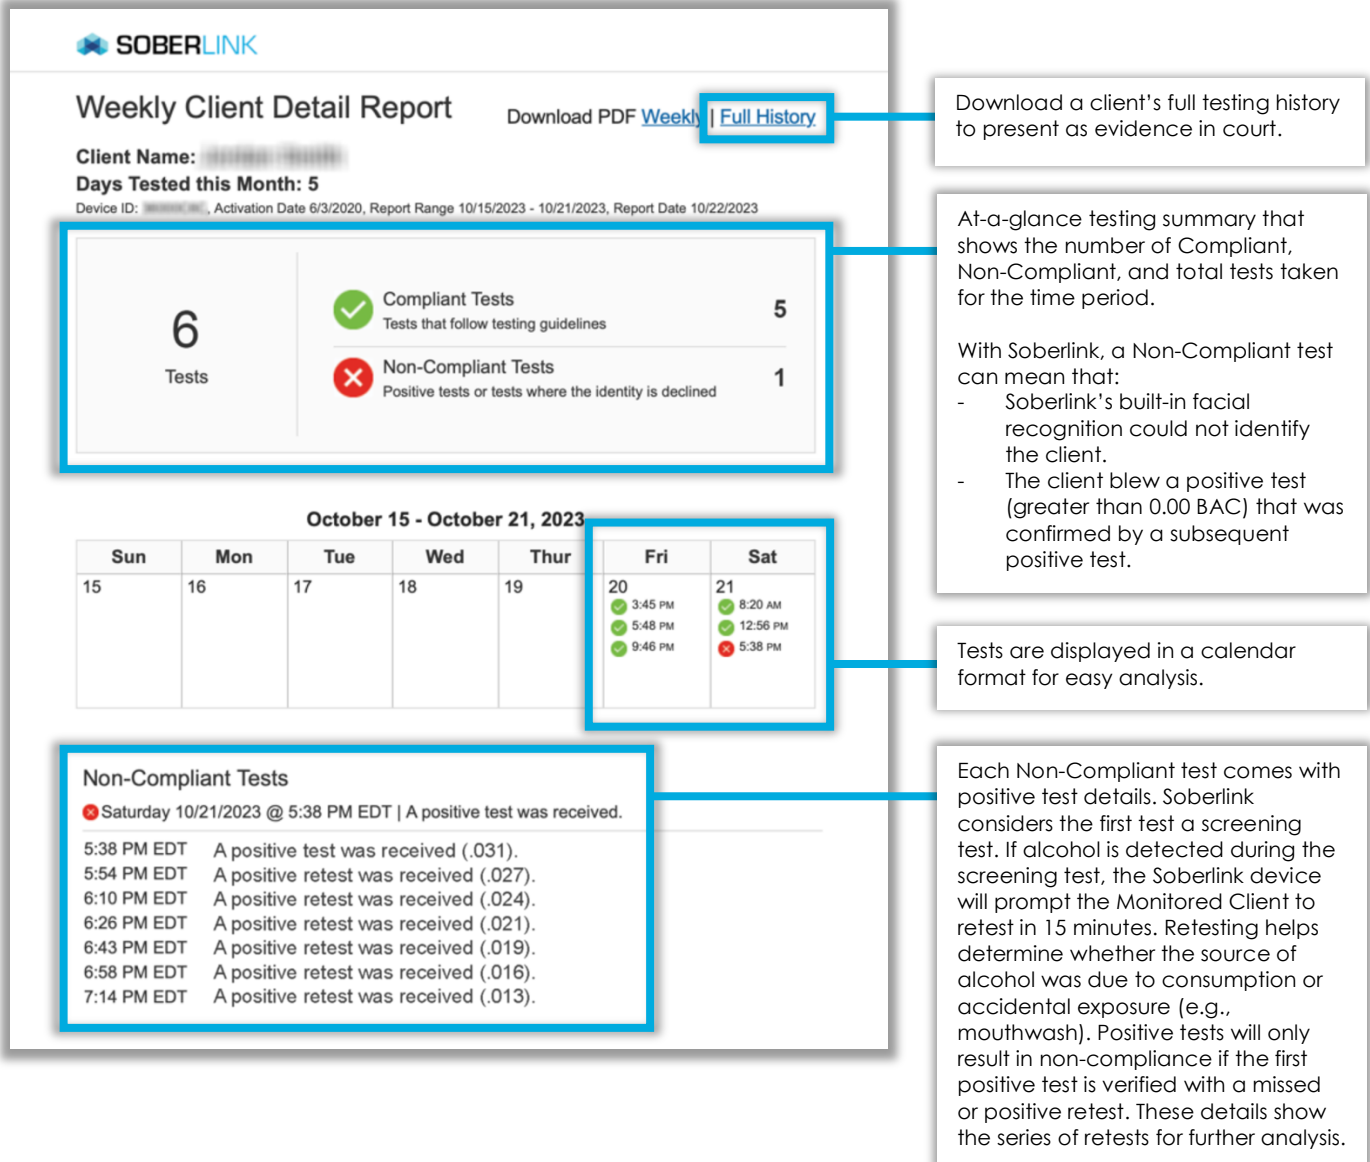

SOBERLINK

Weekly Client Detail Report

Download PDF [Weekly](#) | [Full History](#)

Client Name: [REDACTED]
 Days Tested this Month: 5
 Device ID: [REDACTED], Activation Date 6/3/2020, Report Range 10/15/2023 - 10/21/2023, Report Date 10/22/2023

6 Tests

- ✔ **Compliant Tests** 5
Tests that follow testing guidelines
- ✘ **Non-Compliant Tests** 1
Positive tests or tests where the identity is declined

October 15 - October 21, 2023

Sun	Mon	Tue	Wed	Thur	Fri	Sat
15	16	17	18	19	20	21
					3:45 PM ✔ 5:48 PM ✔ 9:46 PM ✔	8:20 AM ✔ 12:56 PM ✔ 5:38 PM ✘

Non-Compliant Tests

✘ Saturday 10/21/2023 @ 5:38 PM EDT | A positive test was received.

- 5:38 PM EDT A positive test was received (.031).
- 5:54 PM EDT A positive retest was received (.027).
- 6:10 PM EDT A positive retest was received (.024).
- 6:26 PM EDT A positive retest was received (.021).
- 6:43 PM EDT A positive retest was received (.019).
- 6:58 PM EDT A positive retest was received (.016).
- 7:14 PM EDT A positive retest was received (.013).

Download a client's full testing history to present as evidence in court.

At-a-glance testing summary that shows the number of Compliant, Non-Compliant, and total tests taken for the time period.

With Soberlink, a Non-Compliant test can mean that:

- Soberlink's built-in facial recognition could not identify the client.
- The client blew a positive test (greater than 0.00 BAC) that was confirmed by a subsequent positive test.

Tests are displayed in a calendar format for easy analysis.

Each Non-Compliant test comes with positive test details. Soberlink considers the first test a screening test. If alcohol is detected during the screening test, the Soberlink device will prompt the Monitored Client to retest in 15 minutes. Retesting helps determine whether the source of alcohol was due to consumption or accidental exposure (e.g., mouthwash). Positive tests will only result in non-compliance if the first positive test is verified with a missed or positive retest. These details show the series of retests for further analysis.